


NOTES

1. OBTAIN A CITY OF HAGERSTOWN, MD CURB REPLACEMENT PERMIT AND CONTACT MISS UTILITY (1-800-257-7777) BEFORE PROCEEDING WITH ANY EXCAVATION WORK. NOTIFY THE CITY OF HAGERSTOWN, ENGINEERING DIVISION IN ADVANCE OF RESETTING STONE CURB, CONCRETE PLACEMENT, OR BITUMINOUS CONCRETE PLACEMENT.
2. ALL CONCRETE SHALL BE MD DEPT. OF TRANS. S.H.A. MIX NO. 3 WITH A 28 DAY COMPRESSIVE STRENGTH OF 3,500 P.S.I., WITH 5%-8% AIR ENTRAINMENT AND 2"-5" SLUMP. DO NOT ADD WATER TO THE SURFACE FOR FINISHING.
3. CAREFULLY REMOVE AND SALVAGE EXISTING STONE CURB AND RESET ONLY WITH THE APPROVAL OF THE CITY INSPECTOR. DRESS THE TOP EDGE OF THE STONE CURB TO MATCH THE 2% MAXIMUM SLOPE TO THE STREET OF THE SIDEWALK.
4. PLACE AND COMPACT MD DEPT. OF TRANS. S.H.A. GRADED AGGREGATE-BASE (IN 6" MAX. LIFTS TO A MINIMUM OF 95% OF THE MAXIMUM DRY DENSITY OF THE MODIFIED PROCTOR, ASTM D1557-78 OR AASHTO T-180, WITH AN IN PLACE MOISTURE CONTENT OF APPROXIMATELY $\pm 2\%$ OF THE OPTIMUM MOISTURE CONTENT) FOR BEDDING TO CONCRETE SUBGRADE.
5. SUPPORT THE STONE CURB ON GRADE WITH CONCRETE SOLIDS OR CONCRETE BRICK BEFORE CONCRETE PLACEMENT. THE CONCRETE SHALL BE PLACED MONOLITHIC AROUND ALL SIDES OF THE RESET STONE CURB. CONCRETE SHALL STOP AT THAT POINT THAT ALLOWS FOR 1 1/2" MIN. TO 2" MAX. BITUMINOUS CONCRETE TO BE PLACED TO THE STREET FINISH GRADE, AND AT A MIN. OF 4" ABOVE THE BOTTOM OF THE STONE CURB ALONG THE SIDEWALK FACE (REFER TO THE SECTION VIEW). CONCRETE SHALL RECEIVE A RAKED FINISH SURFACE AND TACK COAT PRIOR TO PAVING.

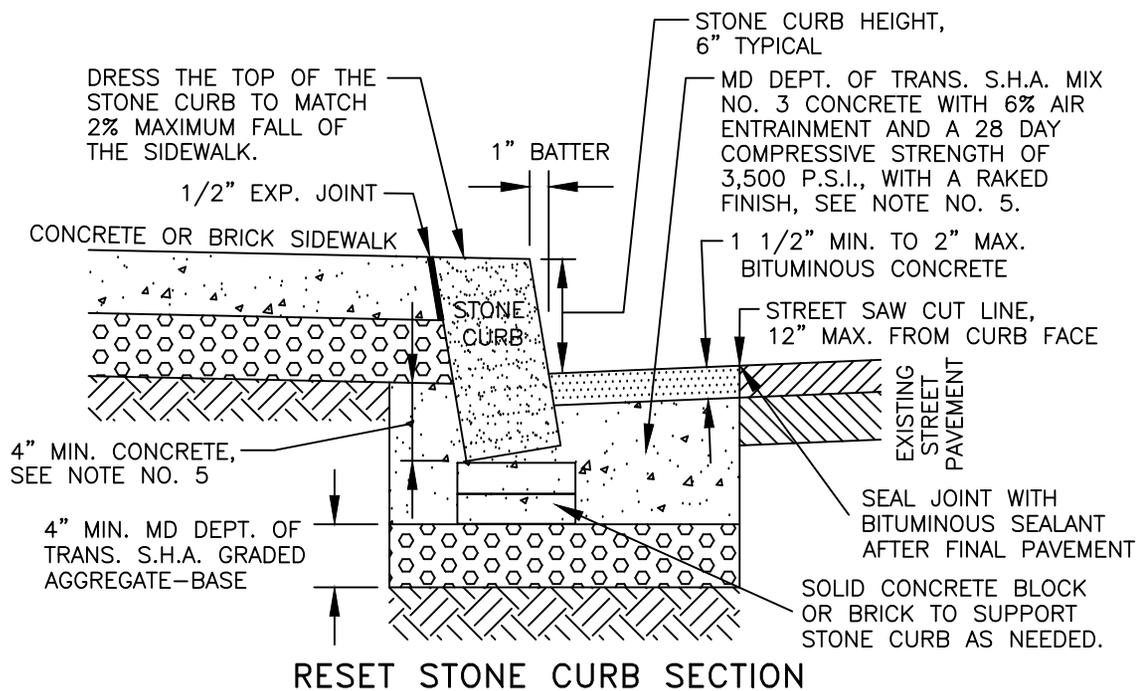

CITY OF HAGERSTOWN, MARYLAND - ENGINEERING DIVISION

**TRANSPORTATION STANDARD DETAIL
THE RESETTING OF
STONE CURB**

ISSUE DATE: 03-01-2018

REVISIONS

Plate T-043

