



CITY OF HAGERSTOWN, MD  
4" STANDARD CONCRETE  
SIDEWALK

**NOTES**


1. THIS TYPE 3 SIDEWALK RAMP SHALL BE CONSTRUCTED AS 4" CITY OF HAGERSTOWN STANDARD SIDEWALK.
2. THE LOCATION OF THE TYPE 3 SIDEWALK RAMP SHALL BE DETERMINED BY CURRENT A.D.A. REQUIREMENTS, EXISTING OBSTRUCTIONS, CROSSWALK LOCATION, THE SIDEWALK ALIGNMENT, AND SHALL BE APPROVED BY THE CITY ENGINEER BEFORE CONSTRUCTION BEGINS.
3. ALL CONCRETE SHALL BE MD DEPT. OF TRANS. S.H.A. MIX NO. 3 WITH A 28 DAY COMPRESSIVE STRENGTH OF 3,500 P.S.I., WITH 5%-8% AIR AND 2"-5" SLUMP. DO NOT ADD WATER TO THE SURFACE FOR FINISHING. ALL EXPOSED SURFACES SHALL RECEIVE A LIGHT TRANSVERSE BROOM FINISH.
4. REFER TO PLATE T-050 FOR STANDARD CONCRETE SIDEWALK, PLATE T-040 FOR STANDARD CONCRETE CURB & GUTTER, AND PLATE T-042 FOR CONCRETE REPLACEMENT (RETROFIT) CURB.
5. THE DOT HATCHED AREA REPRESENTS A DETECTABLE WARNING SURFACE AT THE REQUIRED LOCATION AND ORIENTATION. REFER TO PLATE T-059 FOR THE DETECTABLE WARNING SURFACE SYSTEM SPECIFICATIONS, DETAILS, AND NOTES.

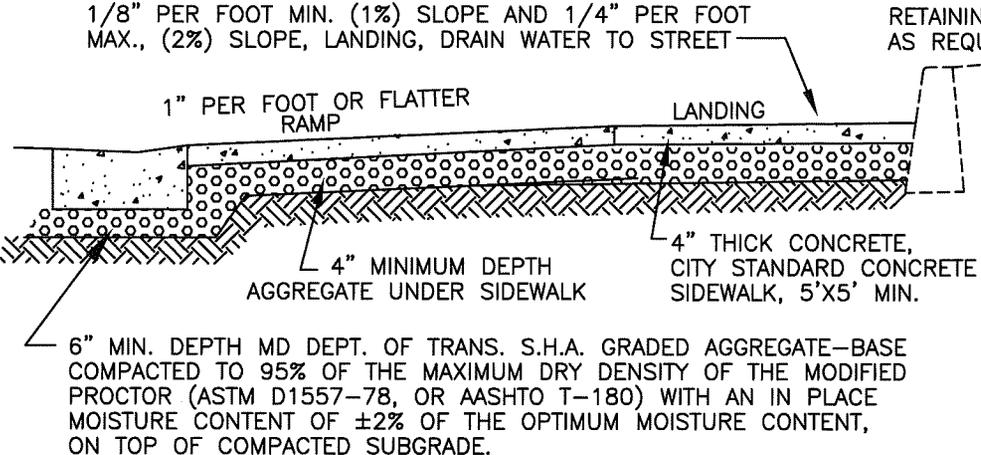

**SECTION AA**  
SEE NOTE NO. 4



**RETAINING WALL CURB**  
N.T.S.

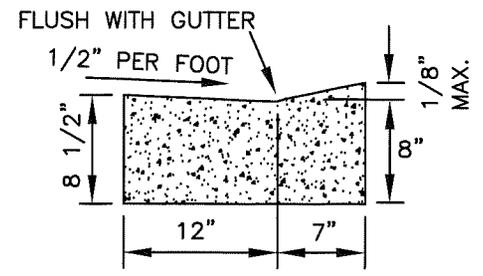

**DEPRESSED CURB & GUTTER DETAIL**  
SEE NOTE NO. 4



CITY OF HAGERSTOWN, MARYLAND – ENGINEERING DIVISION

**TRANSPORTATION STANDARD DETAIL**

**SIDEWALK RAMP TYPE 3 (MID-BLOCK)**

**(BY APPROVAL OF THE CITY ENGINEER ONLY)**

ISSUE DATE: 01-25-2024	
REVISIONS	
01-02-2025	----
----	----

**Plate T-055**