
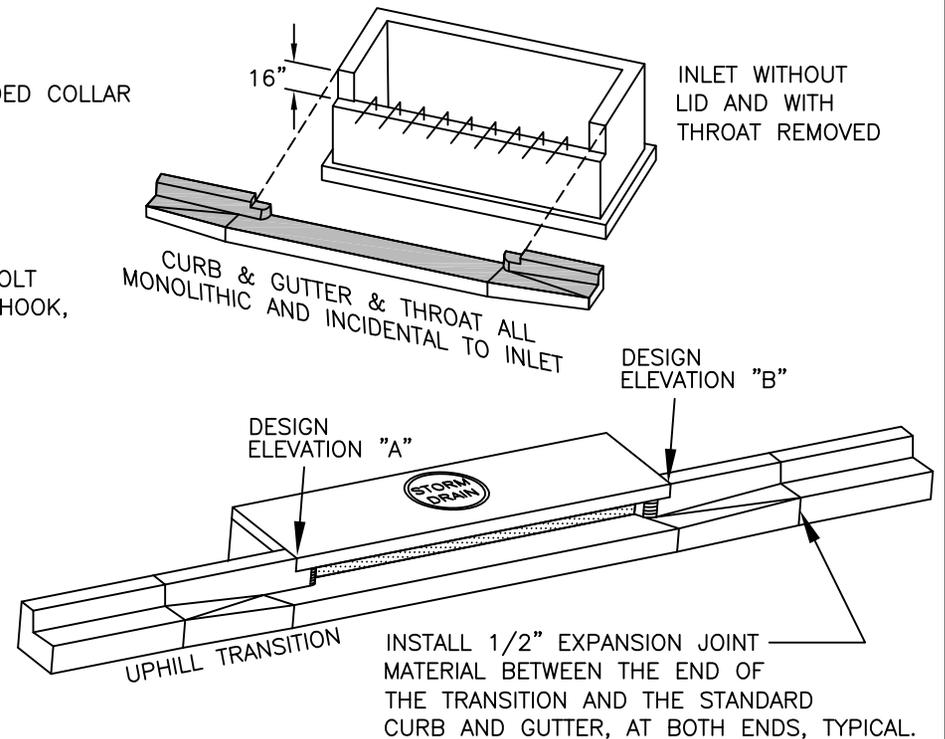


## NOTES

1. EXPOSED GALVANIZED STEEL CHANNEL, PIPE SUPPORTS, AND BASE PLATES SHALL BE PAINTED WITH ONE COAT OF PRIMER AND TWO FINISH COATS OF PAINT (RUST OLEUM NO. 769 RED PRIMER, RUST OLEUM NO. 3286 GRAY FINISH COATS, OR APPROVED EQUALS).
- \* 2. THE 5 1/4" DIMENSION IS BASED ON THE STANDARD 3/8" PER FOOT STREET CROSS SLOPE, BUT SHALL BE ADJUSTED AS NEEDED TO ACCOMMODATE OTHER CROSS SLOPES.
3. REFER TO THE FOLLOWING PLATES FOR ADDITIONAL INFORMATION; LADDER RUNGS IN STORM DRAIN STRUCTURES SD-012, FLOW CHANNELS IN STORM DRAIN STRUCTURES SD-013, GENERAL STRUCTURE NOTES SD-010, AND BACKFILL SD-011.

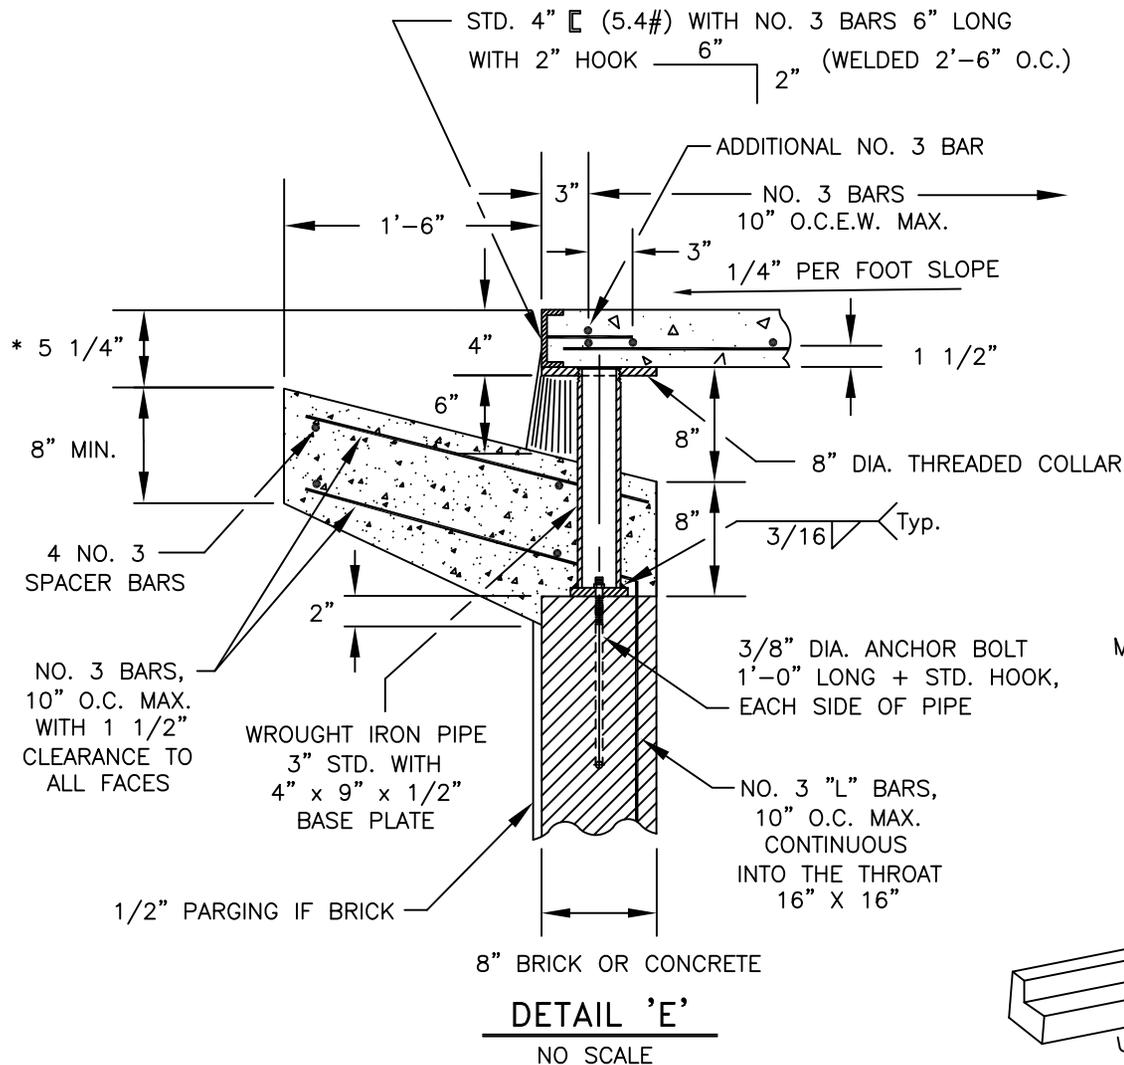

CITY OF HAGERSTOWN, MARYLAND – ENGINEERING AND INSPECTIONS DEPARTMENT

## STORM DRAIN STANDARD DETAIL TYPE "A" CURB OPENING INLET THROAT DETAIL

ISSUE DATE: 01-01-03

REVISIONS

01-01-07	-----
	-----

# Plate SD-021